

CONSTRUCTION TESTING AND ENGINEERING, INC.

P.O. BOX 271125 • SALT LAKE CITY, UTAH 84127-1125

(801) 972-4001 • FAX: (801) 972-4011

SOILS TEST REPORT


CLIENT: Lakeview Rock Products
PROJECT: QC Testing, Upper Pit
RE: 1" Gravel
SPECIFICATION REQUIREMENTS: See target below

DATE: February 5, 2020, Wed.
FILE #: 125 / WO #: 1219

SIEVE ANALYSIS RESULTS
ASTM C 136

Sieve Size	Sieve Opening in mm	Individual % Retained	Accumulated % Retained	**RESULTS** % Passing	Ideal /Tolerance Gradation % Passing
1"	25.0	0	0	100	100
3/4"	19.0	43.2	43.2	56.8	NA
1/2"	12.5	39.8	83.0	17.0	"
3/8"	9.5	10.0	93.0	7.0	"
#4	4.75	2.2	95.2	4.8	"

Test sample dry weight: 5169 grams

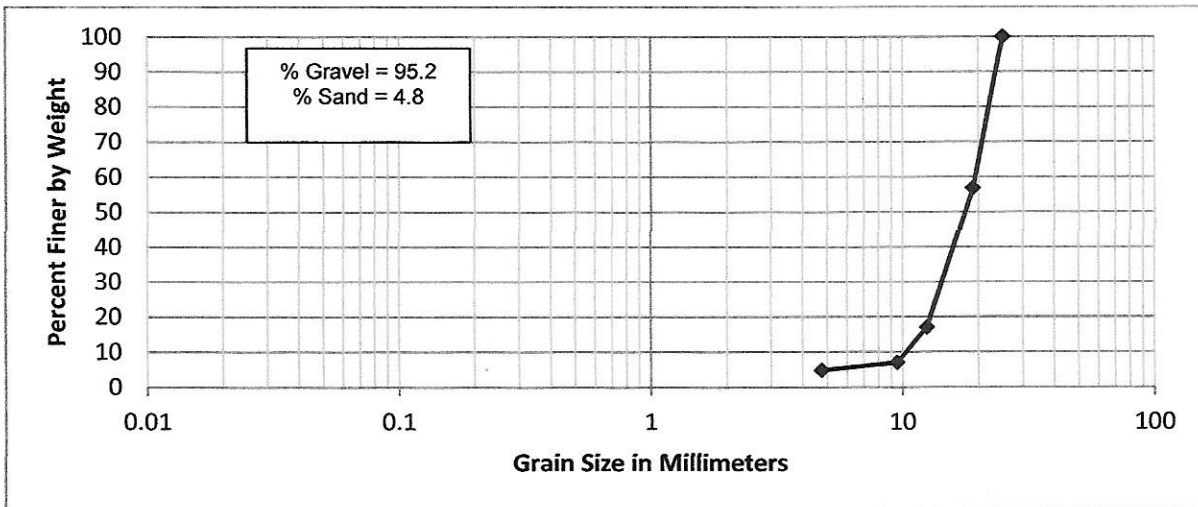

REMARKS:

Source of material: Upper Pit stockpile
Moisture content as received: 2.1%
Gravel physical appearance/shape: Angular

CONSTRUCTION TESTING & ENGINEERING, INC.
CERTIFIED TEST REPORT:

David K. Megeath, Manager